



# Mansfield Municipal Electric Department

# 2022 ANNUAL BENCHMARKING REPORT **eRELIABILITY** TRACKER



# I. About This Report

This report focuses on distribution system reliability across the country and is customized to each utility that participates in the American Public Power Association's eReliability Tracker service. APPA created the eReliability Tracker Annual Report to assist utilities in their efforts to understand and analyze their electric system. In 2012, APPA developed the eReliability Tracker thanks to a grant from the Demonstration of Energy & Efficiency Developments (DEED) program.

This report reflects data in the eReliability Tracker from January 1, 2022 to December 31, 2022. This analysis might not properly reflect your utility's statistics if you do not have a full year of data in the system. The report includes data recorded as of March 14, 2023.

Reliability reflects both historic and ongoing engineering investment decisions within a utility. Proper use of reliability metrics ensures that a utility is performing its intended function and is providing service in a consistent and effective manner.

While the primary use of reliability statistics is for self-evaluation, you can use these statistics to compare your utility with similar utilities. However, differences such as electrical network configuration, ambient environment, weather conditions, and number of customers served typically limit most utility-to-utility comparisons. Due to the diverse range of utilities that use the eReliability Tracker, this report endeavors to improve comparative analyses by grouping utilities by size and region.

Since this report contains data for all utilities that use the eReliability Tracker, it is important to consider how a particularly large or small utility can affect comparative benchmarks. To ease the issues associated with comparability, each utility's reliability statistics are weighted based on customer count when aggregated. This means that all utilities are equally weighted, and all individual statistics are developed on a per customer basis.

The aggregate statistics in this report are calculated from the 285 utilities with verified 2022 outage data. Utilities that experienced no outages in 2022, or did not upload any data, will have NULL, None, or "0" values in their report for utility-specific data and were not included in the aggregate analysis. Also note that log-normal data with a z-score<sup>[1]</sup> greater than 3.25 may be excluded if it significantly distorts the aggregate statistics.

1. A z-score indicates how much a data point differs from the mean. For instance, a z-score of 3.25 indicates that the data point is three and one-quarter standard deviations from the mean. A z-score of 0 indicates that the data point is identical to the mean. [↩](#)

## Utility Classifications


This report separates utilities into groups according to geographic region and the number of customers served. Table 1 shows the range of customer counts for utilities that use the eReliability Tracker by five distinct groups of approximately 105 utilities per group.

Your utility is in size class 4 and region 8.


**Table 1.** Customer count range per size class

Utility Size Class	Customer Count Range
Class 1	[0, 1481)
Class 2	[1481, 3239)
Class 3	[3239, 7154)
Class 4	[7154, 13594)
Class 5	[13594, 503649)

Each utility is also grouped with all other participating utilities within their region. Figure 1 shows the number of utilities using the eReliability Tracker in each region and Figure 2 shows the states and territories included in each region.

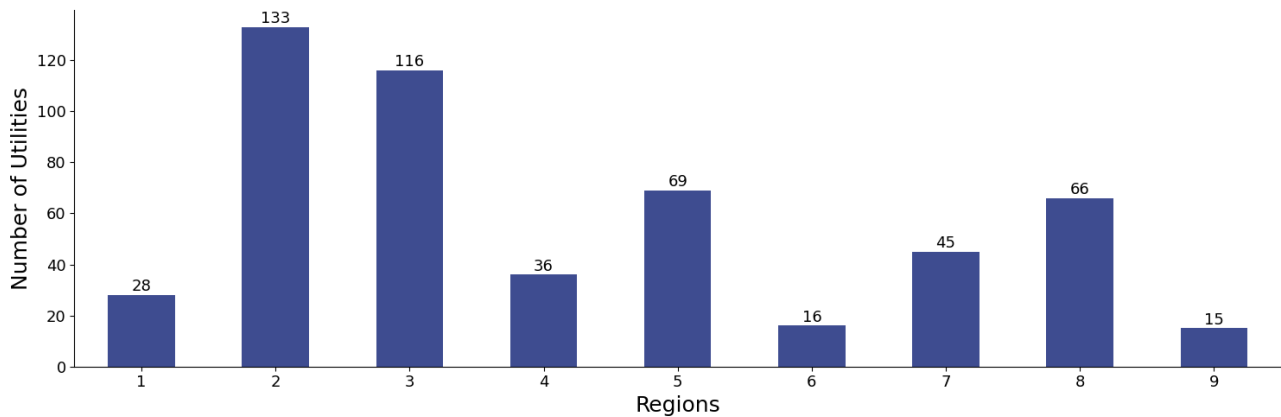

**Figure 1.** Number of utilities subscribed to the eReliability Tracker by region

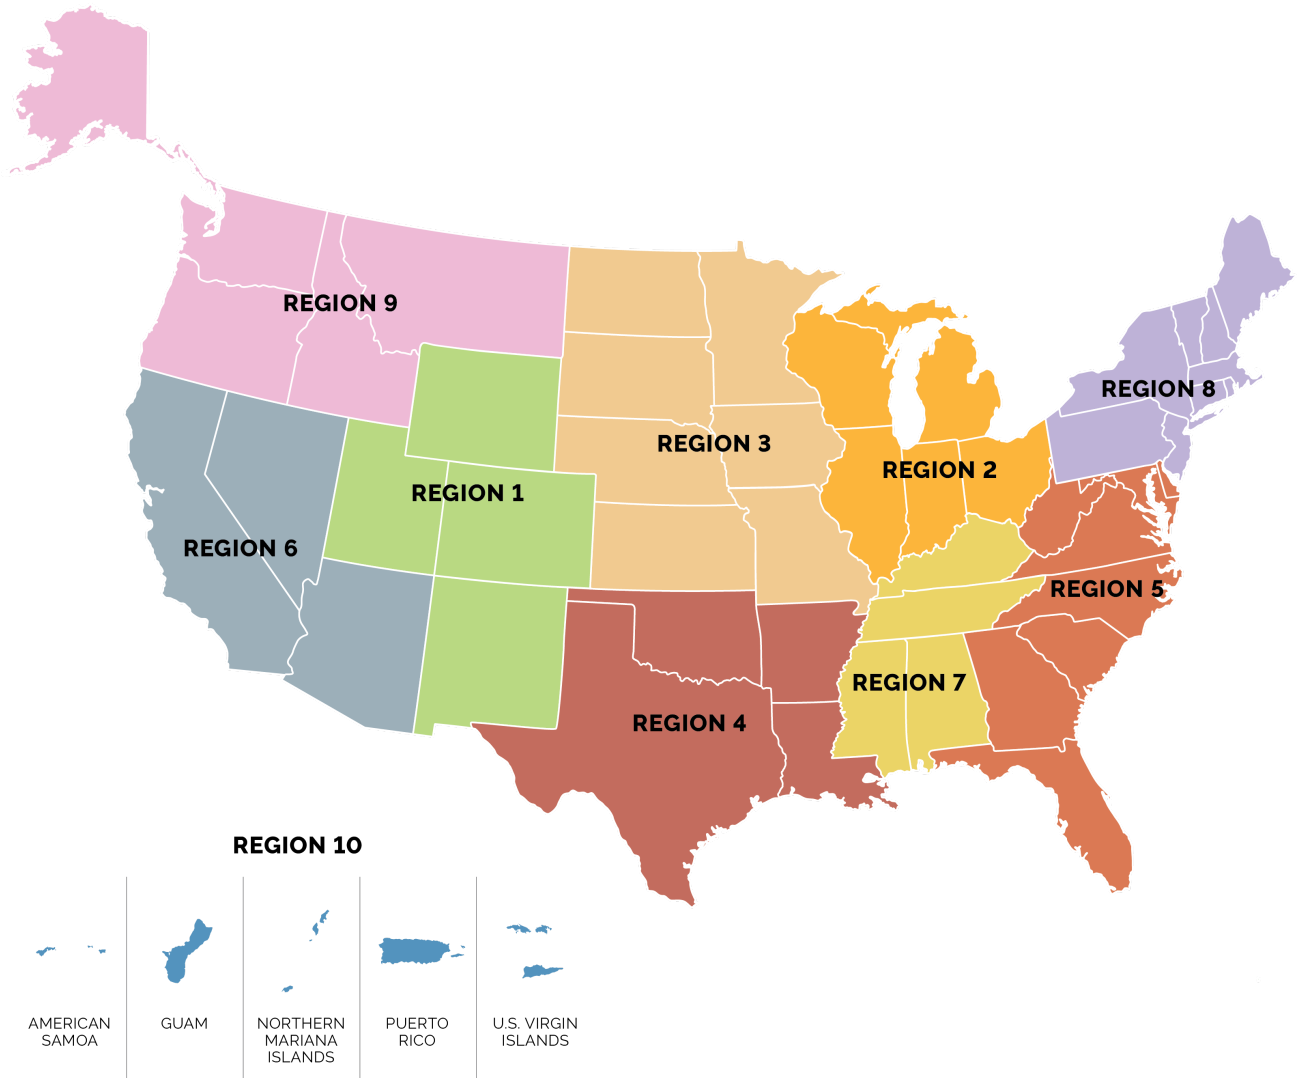

**Figure 2.** Regions

## II. IEEE Statistics

When it comes to reliability, the industry standard metrics are defined in the Institute for Electrical and Electronics Engineers' Guide for Electric Power Distribution Reliability Indices, or IEEE 1366 guidelines. For each utility, the eReliability Tracker performs IEEE 1366 calculations for System Average Interruption Duration Index (SAIDI), System Average Interruption Frequency Index (SAIFI), Customer Average Interruption Duration Index (CAIDI), Momentary Average Interruption Frequency Index (MAIFI) and Average Service Availability Index (ASAI).

It is important to note how major events (MEs) are calculated and used in this report. An example of a ME includes severe weather, such as a tornado or hurricane, that leads to unusually long outages in comparison to your distribution system's typical outage. This report uses the **APPA ME threshold**, which is based directly on the SAIDI for specific outage events, rather than a daily SAIDI. The APPA ME threshold allows a utility to remove outages that exceed the IEEE 2.5 beta threshold for outage events, which considers up to 10 years of the utility's outage history. In the eReliability Tracker, if a utility does not have at least 36 outage events prior to the year being analyzed, then no threshold is calculated. If this is the case for your utility, then you will have a NULL value in the following field and the calculations without MEs in the SAIDI, SAIFI, CAIDI, and ASAI sections of this report will be the same as the calculations with MEs for your utility. More outage history will provide a better threshold for your utility.

Your utility's APPA major event threshold is **3.17** minutes.

For each of the reliability indices, this report displays your utility's metrics alongside the mean values for all utilities using the eReliability Tracker and within the same class and region as your utility. The first table within each of the following subsections allows you to better understand the performance of your electric system relative to other utilities nationwide and to those within your same region or size class. The second table breaks down the national data into quartile ranges, a minimum value, and a maximum value.

All indices, except MAIFI, are calculated for outages with and without MEs. Furthermore, the tables show indices for scheduled and unscheduled outages. Note that scheduled and unscheduled calculations include MEs. Also note that wherever MEs are excluded, the exclusion is based on the APPA ME threshold for your system.

## II.1. System Average Interruption Duration Index

SAIDI is the average duration (in minutes) of an interruption per customer served by the utility during a specific time frame.

Since SAIDI is a sustained interruption index, only outages lasting longer than five minutes are included in the calculations. SAIDI is calculated by dividing the sum of all customer minutes of interruption<sup>[1]</sup> within the specified time frame by the average number of customers served during that period. For example, a utility with 100 customer minutes of interruption and 100 customers would have a SAIDI of 1.

Note that in the tables below, scheduled and unscheduled calculations include MEs. Also note that wherever MEs are excluded, the exclusion is based on the APPA ME threshold for your system.


**Table 2.** Average SAIDI with and without MEs  
In minutes

	All	No MEs	Unscheduled	Scheduled
<b>Your utility</b>	33.88	7.79	33.88	NULL
<b>Utilities that use the eReliability Tracker</b>	115.7	67.27	112.51	5.31
<b>Utilities in your region</b>	46.87	24.47	42.3	9.47
<b>Utilities in your size class</b>	79.21	40.74	76.26	4.22

**Table 3.** Summary SAIDI data from the eReliability Tracker  
In minutes

	All	No MEs	Unscheduled	Scheduled
<b>Minimum</b>	0	0	0	0
<b>First Quartile</b>	18.81	11.32	16.84	0.2
<b>Median</b>	47.3	26.17	46.43	1.1
<b>Third Quartile</b>	118.67	53.61	113.37	4.12
<b>Maximum</b>	3365.08	3365.08	3365.08	122.86

**Figure 3.** Average SAIDI by region

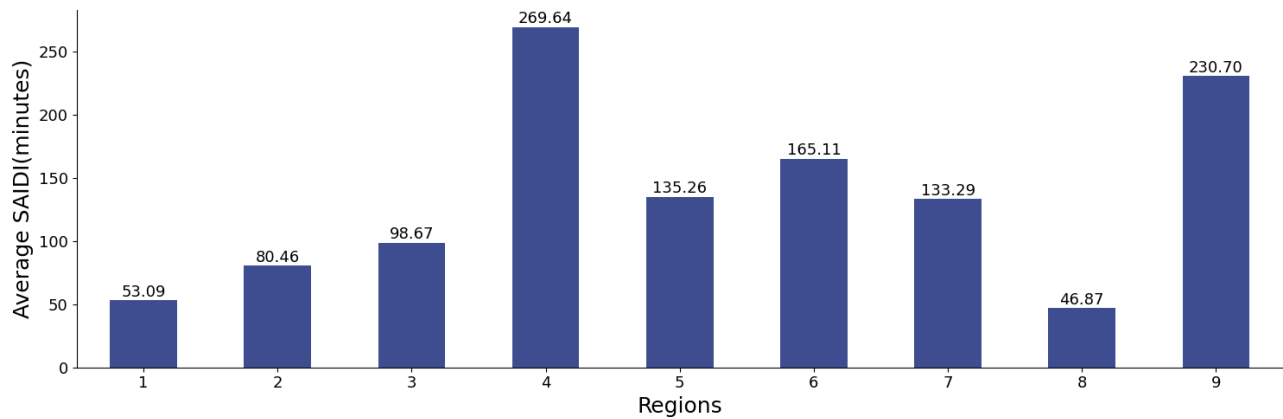

1. Customer minutes of interruption is calculated by multiplying total customers interrupted and total minutes of interruption. [↵](#)

## II.2. System Average Interruption Frequency Index

SAIFI is the average instances a customer on the utility system will experience a sustained interruption during a specific time frame.

Since SAIFI is a sustained interruption index, only outages lasting longer than five minutes are included in the calculations. SAIFI is calculated by dividing the total number of customers that experienced sustained interruptions by the average number of customers served during that period. For example, a utility with 150 customer interruptions and 200 customers would have a SAIFI of 0.75.

Note that in the tables below, scheduled and unscheduled calculations include MEs. Also note that wherever MEs are excluded, the exclusion is based on the APPA ME threshold for your system.


**Table 4.** Average SAIFI with and without MEs  
*In interruptions*

	All	No MEs	Unscheduled	Scheduled
<b>Your utility</b>	0.39	0.06	0.39	NULL
<b>Utilities that use the eReliability Tracker</b>	0.77	0.52	0.74	0.05
<b>Utilities in your region</b>	0.41	0.26	0.37	0.08
<b>Utilities in your size class</b>	0.63	0.41	0.61	0.03

**Table 5.** Summary SAIFI data from the eReliability Tracker  
*In interruptions*

	All	No MEs	Unscheduled	Scheduled
<b>Minimum</b>	0	0	0	0
<b>First Quartile</b>	0.21	0.15	0.2	0
<b>Median</b>	0.59	0.37	0.55	0.01
<b>Third Quartile</b>	1.08	0.72	1.05	0.04
<b>Maximum</b>	3.44	2.92	3.44	1.04

**Figure 4.** Average SAIFI by region

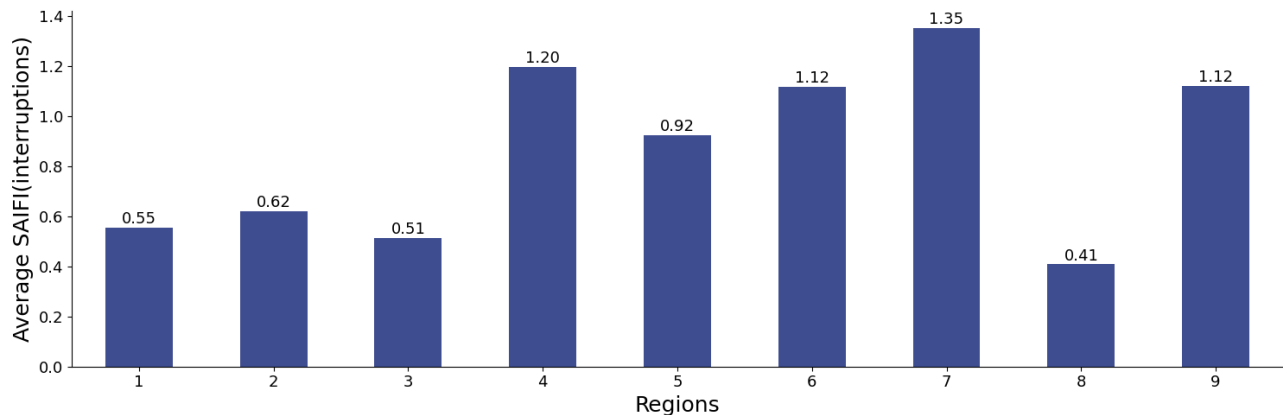



## II.3. Customer Average Interruption Duration Index

CAIDI is the average duration (in minutes) of an interruption experienced by customers during a specific time frame.

Since CAIDI is a sustained interruption index, only outages lasting longer than five minutes are included in the calculations. CAIDI is calculated by dividing the sum of all customer minutes of interruption by the number of customers that experienced one or more interruptions during that period. This metric reflects the average customer experience (minutes of duration) during an outage.

Note that in the tables below, scheduled and unscheduled calculations include MEs. Also note that wherever MEs are excluded, the exclusion is based on the APPA ME threshold for your system.


**Table 6.** Average CAIDI with and without MEs  
In minutes

	All	No MEs	Unscheduled	Scheduled
<b>Your utility</b>	86.72	122.58	86.72	NULL
<b>Utilities that use the eReliability Tracker</b>	126.53	93.65	126.95	112.97
<b>Utilities in your region</b>	115.45	94.87	114.46	106.85
<b>Utilities in your size class</b>	97.17	86.09	96.16	112.35

**Table 7.** Summary CAIDI data from the eReliability Tracker  
In minutes

	All	No MEs	Unscheduled	Scheduled
<b>Minimum</b>	0	0	0	0
<b>First Quartile</b>	64.21	57.12	61.19	53.43
<b>Median</b>	88.09	75.62	86.11	83
<b>Third Quartile</b>	121.48	105.3	122.98	128.43
<b>Maximum</b>	4365.94	1382.29	4504.81	747.38

**Figure 5.** Average CAIDI by region

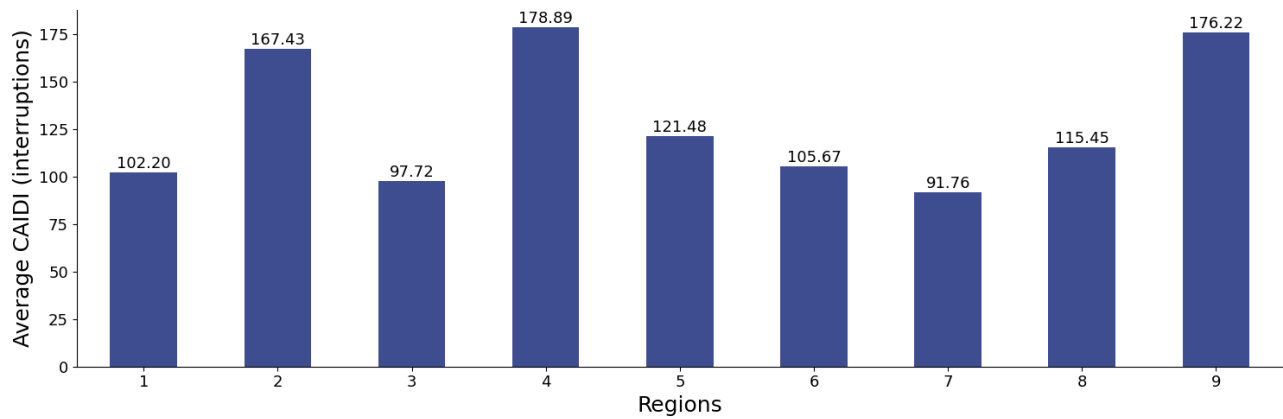

## II.4. Momentary Average Interruption Frequency Index

MAIFI is the average number of momentary interruptions a utility customer will experience during a specific time frame.

In this report, an outage with a duration of five minutes or less is classified as momentary. MAIFI is calculated by dividing the total number of customers that experienced momentary interruptions by the total number of customers served by the utility. For example, a utility with 20 momentary customer interruptions and 100 customers would have a MAIFI of 0.20.

Momentary interruptions can be more difficult to track and utilities without an automated outage management system might not log these interruptions; therefore, some utilities have a MAIFI of zero.


**Table 8.** Average MAIFI  
In interruptions

	MAIFI
<b>Your utility</b>	NULL
<b>Utilities that use the eReliability Tracker</b>	0.48
<b>Utilities in your region</b>	0.49
<b>Utilities in your size class</b>	0.52

**Table 9.** Summary MAIFI data from the eReliability Tracker  
In interruptions

	MAIFI
<b>Minimum</b>	0
<b>First Quartile</b>	0.01
<b>Median</b>	0.12
<b>Third Quartile</b>	0.57
<b>Maximum</b>	5.03

**Figure 6.** Average MAIFI by region

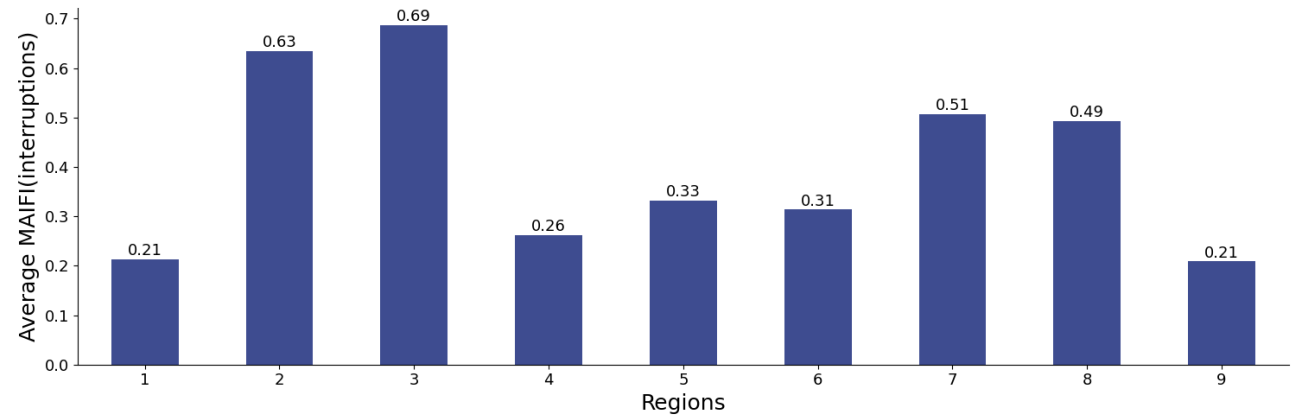

## II.5. Average Service Availability Index

ASAI is the percentage of time the sub-transmission and distribution systems are available to serve customers during a specific time frame.

This load-based index represents the percentage availability of electric service to customers within the period analyzed. It is calculated by dividing the total hours in which service is available to customers by the total hours that service is demanded by the customers. For example, an ASAI of 99.99% means that electric service was available for 99.99% of the time during the given period. Note that the higher your ASAI value, the better the performance.

In the tables below, scheduled and unscheduled calculations include MEs. Also note that wherever MEs are excluded, the exclusion is based on the APPA ME threshold for your system.


**Table 10.** Average ASAI with and without MEs  
In percentage

	All	No MEs	Unscheduled	Scheduled
<b>Your utility</b>	99.9935	99.9985	99.9935	NULL
<b>Utilities that use the eReliability Tracker</b>	99.9783	99.9872	99.9789	99.999
<b>Utilities in your region</b>	99.9919	99.9953	99.9928	99.9981
<b>Utilities in your size class</b>	99.9849	99.9922	99.9855	99.9991

**Table 11.** Summary ASAI data from the eReliability Tracker  
In percentage

	All	No MEs	Unscheduled	Scheduled
<b>Maximum</b>	100	100	100	100
<b>First Quartile</b>	99.9964	99.9978	99.9967	99.9999
<b>Median</b>	99.991	99.995	99.9914	99.9997
<b>Third Quartile</b>	99.9779	99.9898	99.98	99.9992
<b>Minimum</b>	99.3597	99.3597	99.3597	99.9766

**Figure 7.** Average ASAI by region

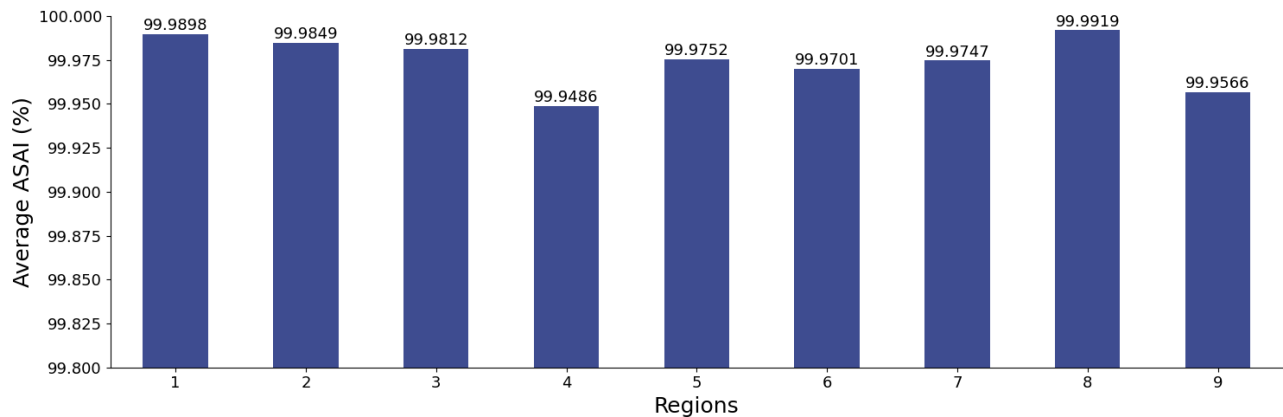

## II.6. Energy Information Administration Form 861 Data

Form EIA-861 collects annual information on electric power industry participants involved in the generation, transmission, distribution, and sale of electric energy in the United States and its territories.

In 2014, EIA began publishing reliability statistics in Form EIA-861; therefore, APPA included these statistics in this report for informational purposes. Please note that the following data includes 175 investor-owned, 464 rural cooperative, and 323 public power utilities that were large enough to be required to fill out the full EIA-861 form. The statistics do not include data from utilities that complete the EIA 861-S form, which smaller entities complete. Note that the 323 participating public power utilities include entities classified by EIA as municipal, political subdivision, and state. In addition, since the collection and release of EIA form data lags by a year, the data is based on 2021 data that was published October 6, 2022. Therefore, we suggest you only use the aggregate statistics contained herein as an informational tool for further comparison of reliability statistics.

In Form EIA-861, an entity provides SAIDI and SAIFI including and excluding ME days in accordance with the IEEE 1366-2003 or IEEE 1366-2012 standard.

Although EIA collected other reliability-related data, the tables below only include SAIDI and SAIFI data including and excluding ME days. You can download the full set of data at: [www.eia.gov/electricity/data/eia861/](http://www.eia.gov/electricity/data/eia861/).

**Table 12.** Your utility's SAIDI and SAIFI with and without IEEE ME days

SAIDI with IEEE ME days (minutes)	SAIDI without IEEE ME days (minutes)	SAIFI with IEEE ME days (interruptions)	SAIFI without IEEE ME days (interruptions)
33.88	5.34	0.39	0.06

**Table 13.** Summary SAIDI data from Form EIA-861, 2021  
*In minutes*

	All	No MEs
<b>Average</b>	464	140.45
<b>Minimum</b>	0.31	0
<b>First Quartile</b>	84.75	53.07
<b>Median</b>	162.2	97.17
<b>Third Quartile</b>	327	164.26
<b>Maximum</b>	31626	3148

**Table 14.** Summary SAIFI data from Form EIA-861, 2021  
*In interruptions*

	All	No MEs
<b>Average</b>	1.71	1.21
<b>Minimum</b>	0	0
<b>First Quartile</b>	0.85	0.63

	<b>All</b>	<b>No MEs</b>
<b>Median</b>	1.32	1
<b>Third Quartile</b>	2.06	1.52
<b>Maximum</b>	19.09	7.77

## II.7. Miles of Line and Interruptions

Analyzing interruptions by miles of line can help utilities explore the relationship between outages, distribution line exposure, and customer density. This analysis separates utilities into groups of similar average customer density (customers served per mile). As shown in Table 16, utilities that use the eReliability Tracker were split into five customer density groups of approximately 46 utilities each. Note that customer density classes include utilities that either provided their miles of line data in the 2022 eReliability Tracker data verification survey or recorded their data in the eReliability Tracker. You can use the miles of line-related metrics shown in Table 15 and Table 16 as an additional benchmark for your utility's reliability along with the customer normalized-metrics included in the rest of the report. These metrics can be helpful in understanding, for example, utility reliability against weather and animal-related outages relative to similarly dense and exposed utilities.

Your utility's total miles of line: **NULL**

Your utility's overhead miles of line: **NULL**

Your utility's underground miles of line: **NULL**

**Table 15.** Total miles of line and interruptions

	<b>Customers Interrupted per Mile</b>	<b>Interruptions per Mile</b>	<b>Minutes of Interruption per Mile</b>
<b>Your utility</b>	<b>NULL</b>	<b>NULL</b>	<b>NULL</b>
<b>Utilities that use the eReliability Tracker</b>	31.29	0.5	126
<b>Utilities in your region</b>	20.74	0.47	59.23

Your utility's customer density (customers per mile): **NULL**


Your utility belongs to customer density class **NULL**.

**Table 16.** Miles of line-related metrics by customer density class

<b>Customer Density Class (Customers per Mile)</b>	<b>Customer Density Range</b>	<b>Average Customers Interrupted per Mile</b>	<b>Average Interruptions per Mile</b>	<b>Average Minutes of Interruption per Mile</b>
Class 1	0.0 - 20.85	18.25	0.29	60.47
Class 2	20.85 - 35.27	21.74	0.38	89.12
Class 3	35.27 - 46.79	25.28	0.42	267.1
Class 4	46.79 - 63.41	38.43	0.62	114.39
Class 5	63.41 - 917.68	54.95	0.77	83.08

# III. Outage Causes

Equipment failure, extreme weather events, wildlife, and vegetation are some of the most common causes of electric system outages. The following pie chart shows the percentages of the primary causes of outages for all utilities using the eReliability Tracker in 2022.

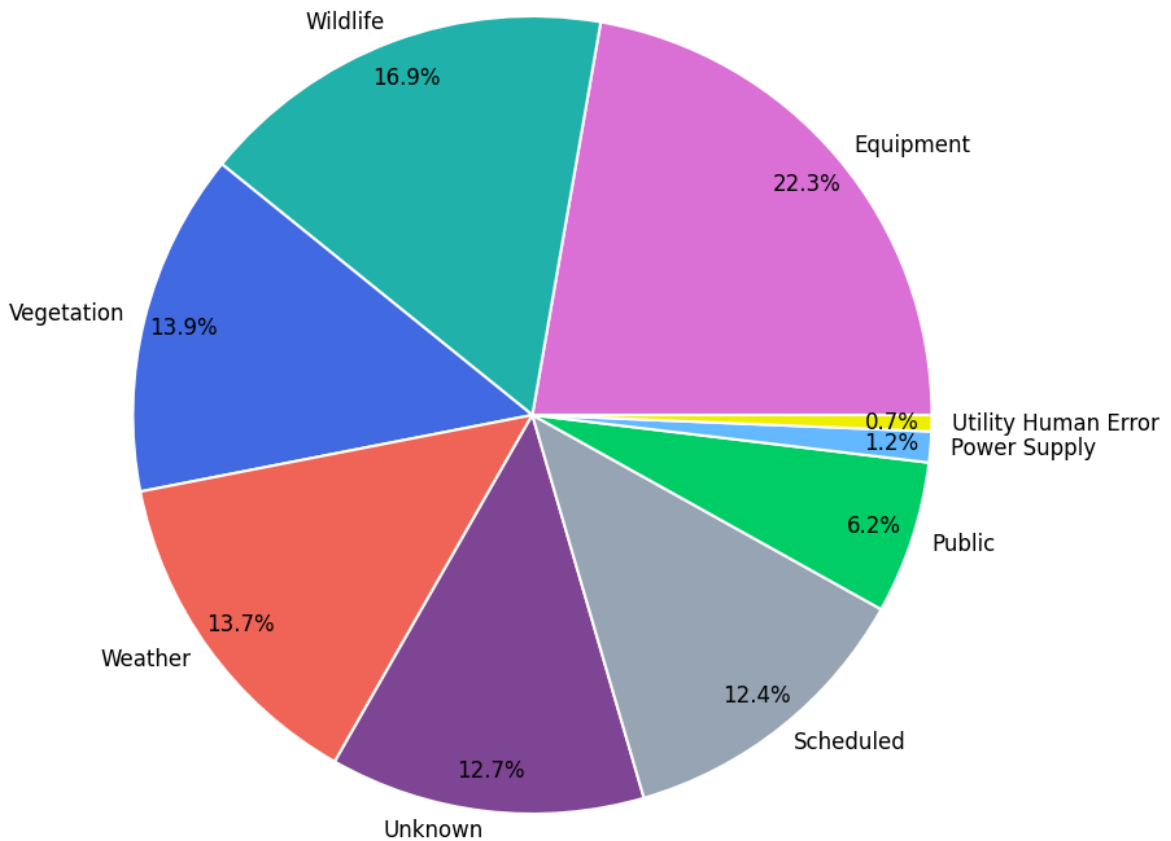

**Figure 8.** Primary causes of outages in 2022

Certain factors, such as regional weather and animal/vegetation patterns, can make some causes more prevalent for a specific group of utilities. The following section includes graphs depicting common causes of outages for your utility, all utilities in your region, and all utilities using the eReliability Tracker.

Charts containing aggregate information are customer-weighted to account for differences in utility size for a better analytical comparison. For example, a particularly large utility may have a large number of outages compared to a small utility. To avoid skewing the data toward large utilities, the number of cause occurrences is divided by customer size to account for the differences. In Figures 9 -14, the data represent the

number of occurrences for each group of 1,000 customers. A customer-weighted occurrence rate of "1" means an average of one outage from that cause occurred per 1,000 customers in 2022.


Note that the sustained outage cause analysis is more comprehensive than the momentary outage cause analysis due to a larger and more robust sample size for sustained outages. Regardless, tracking both sustained and momentary outages helps utilities understand and reduce outages. To successfully use the outage information tracked by your utility, it is imperative to classify and record outages in detail. The more information provided per outage, the more conclusive and practical your analyses will be.




### III.1. Sustained Outage Causes

In general, sustained outages are the most commonly tracked outage type. In analyses of sustained outages, utilities tend to exclude scheduled outages, partial power, customer-related problems, and qualifying major events from their reliability indices calculations. While this is a valid method for reporting, these outages should be included for internal review to make utility-level decisions. In this section, we evaluate common causes of sustained outages for your utility, corresponding region, and for all utilities that use the eReliability Tracker. It is important to note that sustained outages are classified in this report as outages that last longer than five minutes, as defined by IEEE 1366.

**Figure 9.** Top five causes of sustained outages for all utilities that use the eReliability Tracker

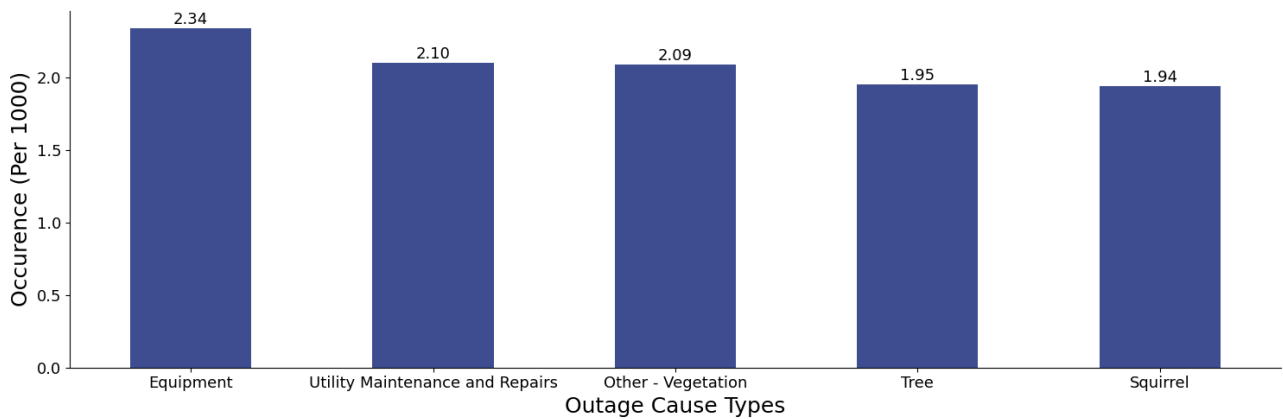


**Figure 10.** Top five causes of sustained outages for your utility<sup>[1]</sup>

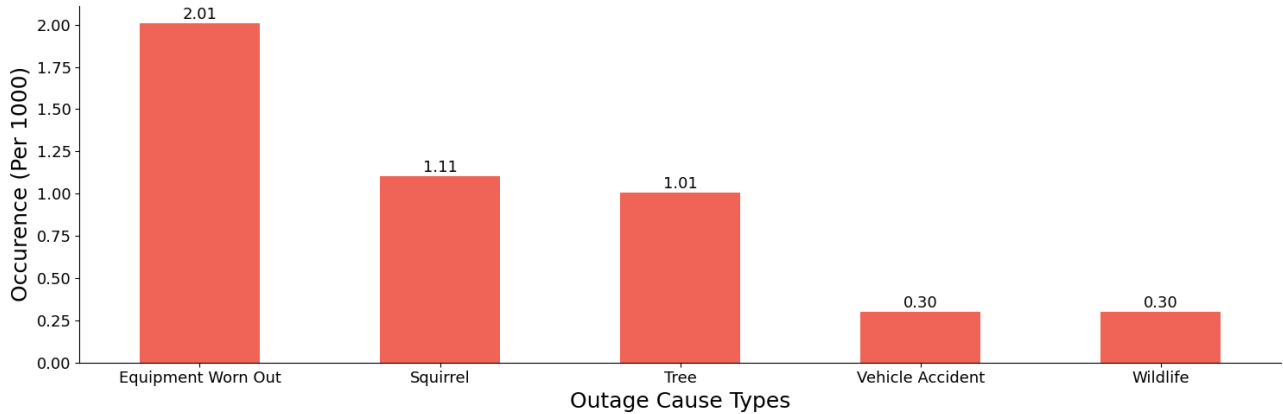

1. The number of occurrences for each cause is divided by the utility's customer count (in thousands) to create an occurrence rate that can be compared across different utility sizes. [↩](#)


**Figure 11.** Top five causes of sustained outages in your region

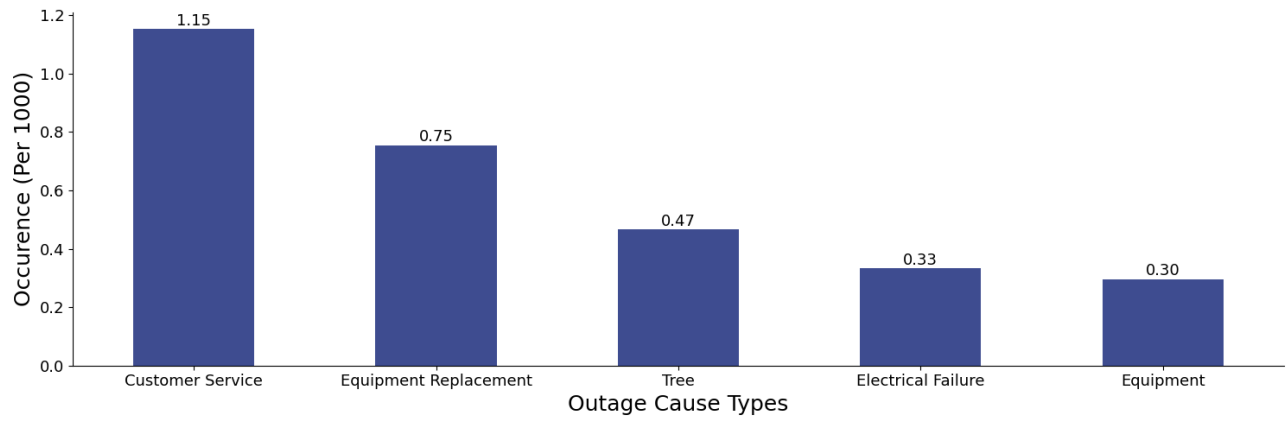


### III.2. Momentary Outage Causes

The ability to track momentary outages can be difficult or unavailable on some systems, but due to the hazard they pose for electronic equipment, it is important to track and analyze the causes of momentary outages. This section evaluates the common causes of momentary outages for your utility, region, and size class as well as common causes for all utilities that use the eReliability Tracker. Please note that only outages lasting less than five minutes are classified as momentary, as defined by IEEE 1366. In Figures 12-14, for each utility, the number of occurrences for each cause is divided by that utility's customer count (in thousands) to create an occurrence rate that can be compared across different utility sizes.


**Figure 12.** Top five causes of momentary outages for all utilities that use the eReliability Tracker

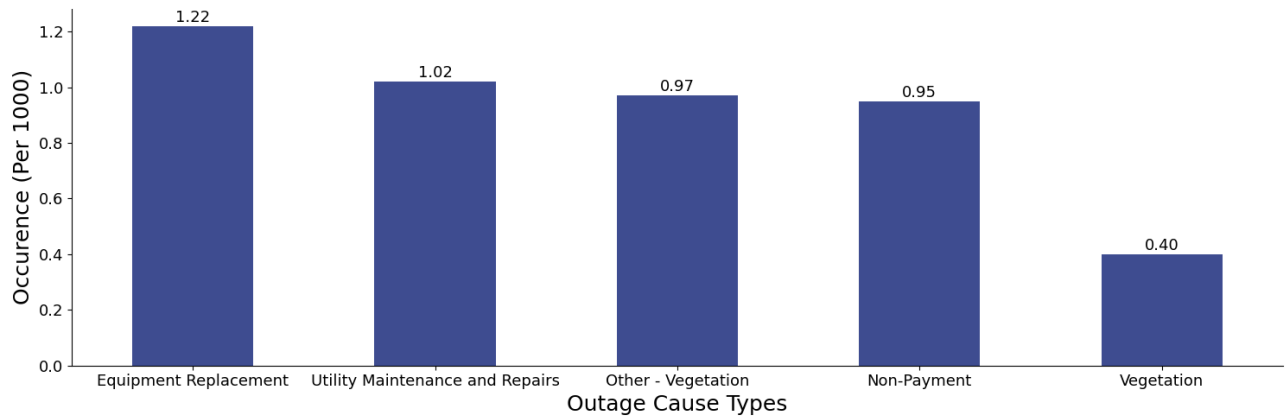

**Figure 13.** Top five causes of momentary outages for your utility

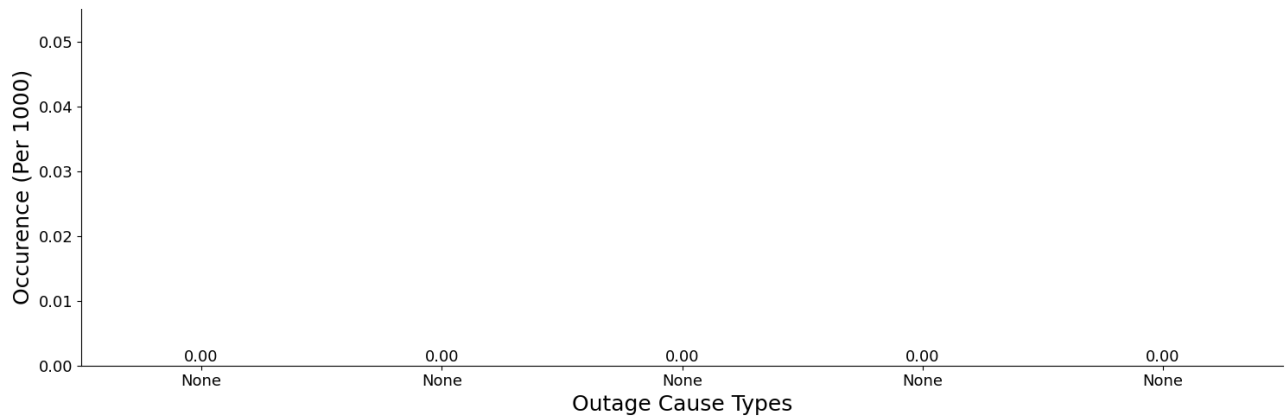

**Figure 14.** Top five causes of momentary outages in your region

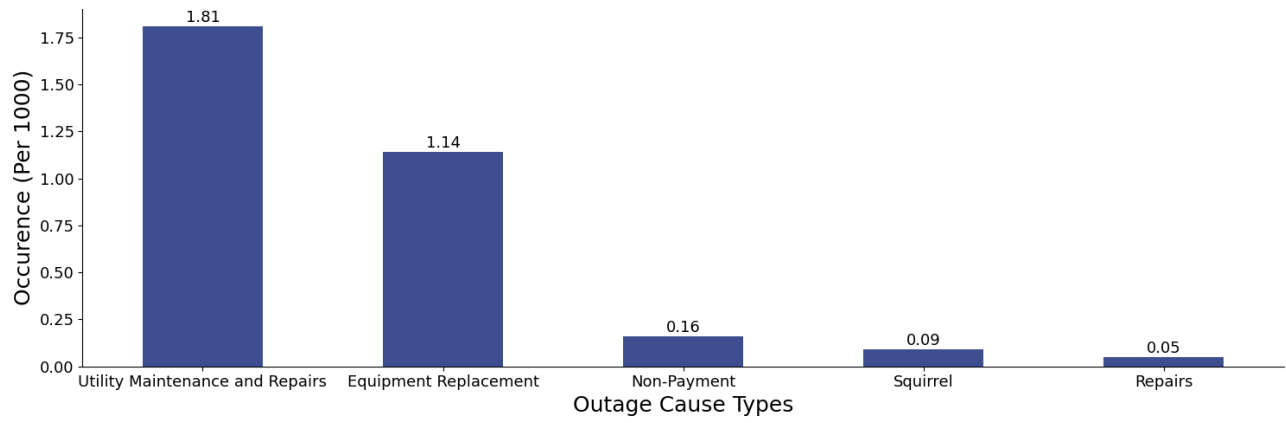

Thank you for your active participation in the eReliability Tracker service. We hope this report is useful to your utility in analyzing your system. If you have any questions regarding the material provided in this report, please contact:

*APPA's Reliability Team*  
Paul Zummo  
Ji Yoon Lee  
Matthew Atienza  
[Reliability@PublicPower.org](mailto:Reliability@PublicPower.org)

*American Public Power Association*  
2451 Crystal Drive, Suite 1000  
Arlington, VA 22202

For more information on reliability, visit [www.PublicPower.org/Reliability](http://www.PublicPower.org/Reliability).



Powering Strong Communities

2451 Crystal Drive  
Suite 1000  
Arlington, VA 22202-4804  
[www.PublicPower.org](http://www.PublicPower.org)

Copyright 2023 by the American Public Power Association. All rights reserved.